

Floodlight Summary:

Report based on lamp delivering 1000 lumens.

Maximum Intensity	16200.4 cd per klm.
(Luminaire orientation as tested.)	3.0 degrees vertical
	0.0 degrees horizontal

Beam Spread	At 10% of Imax	26.3V x 18.2H
	At 50% of Imax	12.8V x 9.4H
	At 90% of Imax	4.7V x 3.4H

Beam Flux	Total	1002.0 lumens per klm.
	To 10% of Imax	734.8 lumens per klm.
	To 50% of Imax	355.1 lumens per klm.
	To 90% of Imax	50.0 lumens per klm.

Upward LOR	2.0 %
Downward LOR	98.2 %


Luminaire Efficiency (Light Output Ratio)	100.0 %
---	---------

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 30DEG
Operators: Simon
Test Date: 2019-08-28

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-2000A_V1 SYSTEM V2.00.417
Humidity: 65.0%
Test Distance: 11.510m [K=1.0000]
Remarks:

LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:220.74V I:0.0651A P:13.489W PF:0.9381 Freq:50.01Hz Lamp Flux:343.348x1 lm		
NAME: ProPoint Sconce M Green 10Dx5D	TYPE:Sconce	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:1
MFR.: Traxon Technologies	SUR.:	Shielding Angle:

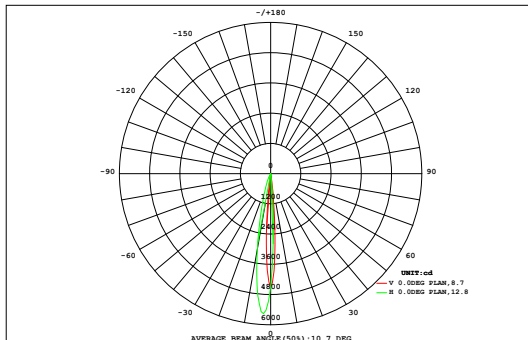

DATA OF LAMP		Eff:25.45lm/W	
MODEL	XPE2	Imax (cd)	5562
NOMINAL POWER (W)	15	AVAILABILITY (%)	72.6
RATED VOLTAGE (V)	AC 220	Avai. FLUX (lm)	249.1
NOMINAL FLUX (lm)	343.348	LOR (%)	100.0
LAMPS INSIDE	1	TOTAL FLUX (lm)	343.3
TEST VOLTAGE (V)	AC 220	θ @50% (H,V)	9,13DEG

	AREA FLUX DIAGRAM																UNIT:lm		Φ t	Φ a
	0.15	0.22	0.33	0.46	0.63	0.82	0.97	1.08	1.16	1.15	1.05	0.92	0.77	0.58	0.41	0.28	0.18	0.12	11.3	8.10
18	0.16	0.24	0.37	0.54	0.77	1.06	1.31	1.49	1.62	1.61	1.44	1.24	0.98	0.70	0.47	0.31	0.20	0.13	14.6	11.9
16	0.16	0.26	0.40	0.62	0.93	1.32	1.76	2.04	2.26	2.24	1.98	1.66	1.22	0.82	0.52	0.32	0.21	0.13	18.8	16.4
14	0.15	0.25	0.41	0.67	1.06	1.60	2.26	2.75	3.10	3.07	2.67	2.13	1.46	0.92	0.55	0.33	0.20	0.12	23.7	21.4
12	0.11	0.21	0.39	0.68	1.14	1.84	2.72	3.57	4.10	4.06	3.47	2.58	1.67	0.98	0.56	0.32	0.18	0.10	28.7	26.5
10	0.07	0.14	0.31	0.62	1.14	1.97	3.10	4.35	5.14	5.12	4.27	2.97	1.80	1.00	0.52	0.25	0.12	0.06	32.9	31.2
8	0.06	0.11	0.20	0.44	0.97	1.90	3.29	4.88	6.00	6.02	4.88	3.21	1.79	0.87	0.37	0.17	0.09	0.06	35.3	33.7
6	0.06	0.10	0.18	0.35	0.73	1.58	3.09	4.99	6.38	6.45	5.09	3.11	1.53	0.66	0.30	0.15	0.08	0.06	34.9	33.0
4	0.05	0.08	0.13	0.25	0.55	1.26	2.59	4.39	5.79	5.92	4.50	2.60	1.18	0.49	0.22	0.11	0.07	0.05	30.2	28.4
2	0.04	0.06	0.09	0.16	0.35	0.84	1.83	3.27	4.38	4.31	3.26	1.80	0.77	0.30	0.14	0.08	0.06	0.04	21.8	20.0
0	0.04	0.05	0.07	0.11	0.20	0.46	0.99	1.81	2.52	2.51	1.80	0.98	0.44	0.18	0.10	0.07	0.05	0.04	12.4	10.6
-2	0.04	0.05	0.06	0.08	0.12	0.22	0.42	0.79	1.07	1.07	0.79	0.41	0.21	0.12	0.08	0.06	0.05	0.04	5.67	3.46
-4	0.04	0.05	0.05	0.07	0.09	0.11	0.19	0.28	0.37	0.37	0.27	0.18	0.11	0.08	0.07	0.05	0.04	0.04	2.46	0.00
-6	0.04	0.05	0.05	0.06	0.07	0.09	0.11	0.13	0.16	0.16	0.13	0.11	0.09	0.07	0.06	0.05	0.05	0.04	1.50	0.00
-8	0.05	0.05	0.06	0.06	0.07	0.08	0.09	0.09	0.10	0.10	0.09	0.09	0.08	0.07	0.06	0.06	0.05	0.05	1.29	0.00
-10	0.05	0.06	0.06	0.07	0.07	0.08	0.08	0.09	0.09	0.09	0.09	0.09	0.08	0.08	0.07	0.07	0.06	0.06	1.29	0.00
-12	0.06	0.07	0.07	0.07	0.08	0.08	0.09	0.09	0.09	0.09	0.09	0.09	0.09	0.08	0.08	0.07	0.07	0.06	1.38	0.00
-14	0.07	0.07	0.08	0.08	0.08	0.09	0.09	0.09	0.10	0.10	0.09	0.09	0.09	0.08	0.08	0.07	0.07	0.07	1.49	0.00
-16	0.07	0.07	0.08	0.08	0.08	0.09	0.09	0.09	0.10	0.10	0.09	0.09	0.09	0.08	0.08	0.07	0.07	0.07	1.49	0.00
-18	0.07	0.07	0.08	0.08	0.08	0.09	0.09	0.09	0.10	0.10	0.09	0.09	0.09	0.08	0.08	0.07	0.07	0.07	1.49	0.00
	-18	-16	-14	-12	-10	-8	-6	-4	HORIZONTAL (DEG)	4	6	8	10	12	14	16	18			
Φ t	1.42	2.11	3.31	5.39	9.05	15.4	25.0	36.2	44.4	44.4	36.0	24.3	14.4	8.07	4.65	2.81	1.82	1.25	280	---
Φ a	0.00	0.00	0.00	1.30	6.81	14.2	23.9	35.3	43.5	43.5	35.1	23.1	12.9	5.20	0.00	0.00	0.00	0.00	---	245

one-half-peak spread: U:5.2,D:7.7 , L:4.7,R:4.8


NEMA Beam Type: Type 2

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:30DEG
 Operators:Simon
 Test Date:2019-08-28

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.417
 Humidity:65.0%
 Test Distance:11.510m [K=1.0000]
 Remarks:

ISOCANDELA DIAGRAM

Test:U:220.74V I:0.0651A P:13.489W PF:0.9381 Freq:50.01Hz Lamp Flux:343.348x1 lm		
NAME: ProPoint Sconce M Green 10Dx5D	TYPE:Sconce	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:1
MFR.: Traxon Technologies	SUR.:	Shielding Angle:

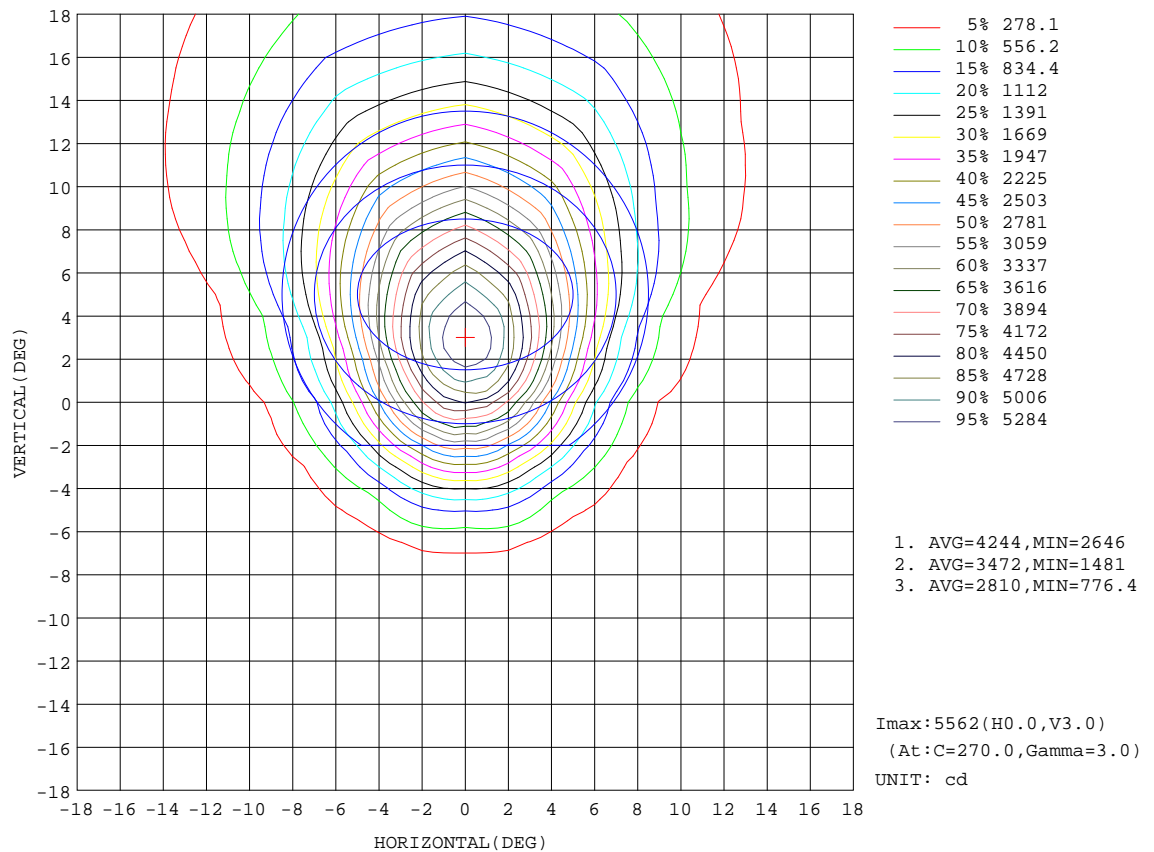


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:30DEG
Operators:Simon
Test Date:2019-08-28

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.417
Humidity:65.0%
Test Distance:11.510m [K=1.0000]
Remarks:

ISOLUX DIAGRAM


Test:U:220.74V I:0.0651A P:13.489W PF:0.9381 Freq:50.01Hz Lamp Flux:343.348x1 lm		
NAME: ProPoint Sconce M Green 10Dx5D	TYPE:Sconce	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:1
MFR.: Traxon Technologies	SUR.:	Shielding Angle:

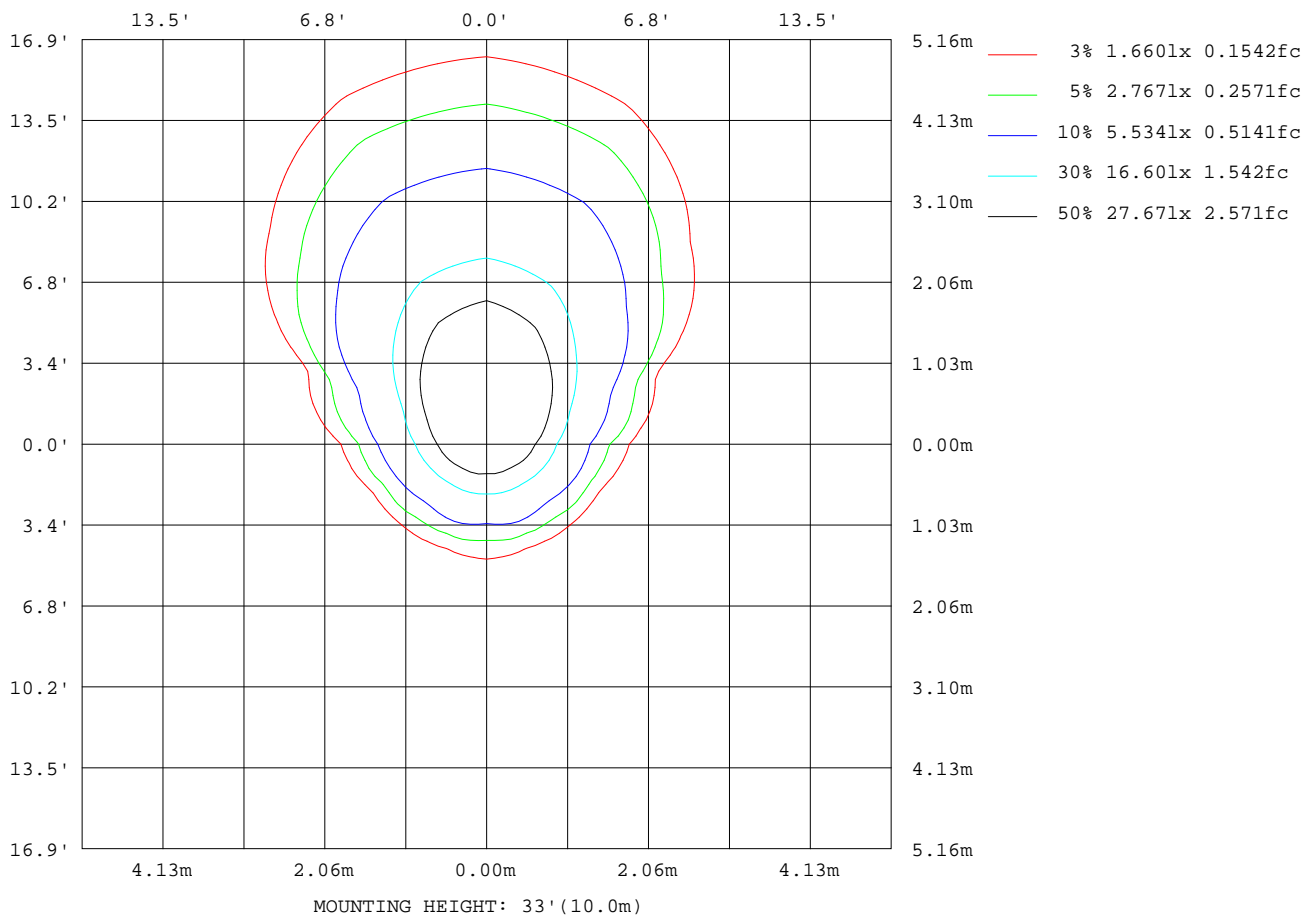

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 30DEG
 Operators: Simon
 Test Date: 2019-08-28

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-2000A_V1 SYSTEM V2.00.417
 Humidity: 65.0%
 Test Distance: 11.510m [K=1.0000]
 Remarks:

Planar Illuminance Curve

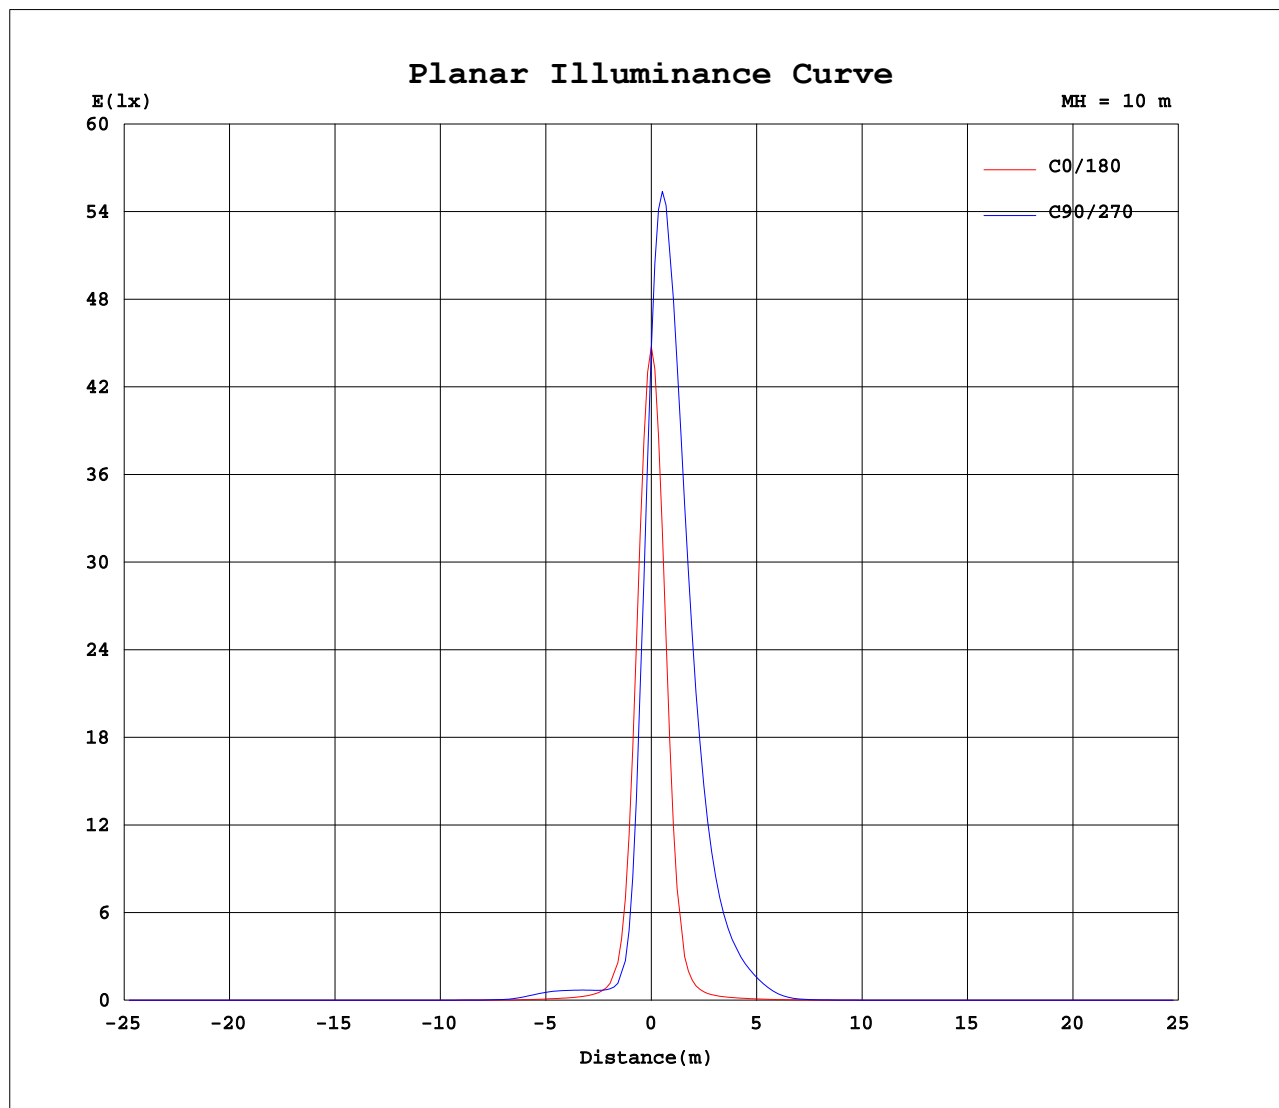


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 30DEG
Operators: Simon
Test Date: 2019-08-28

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-2000A_V1 SYSTEM V2.00.417
Humidity: 65.0%
Test Distance: 11.510m [K=1.0000]
Remarks:

AAI Figure

Test:U:220.74V I:0.0651A P:13.489W PF:0.9381 Freq:50.01Hz Lamp Flux:343.348x1 lm		
NAME: ProPoint Sconce M Green 10Dx5D	TYPE:Sconce	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:1
MFR.: Traxon Technologies	SUR.:	Shielding Angle:

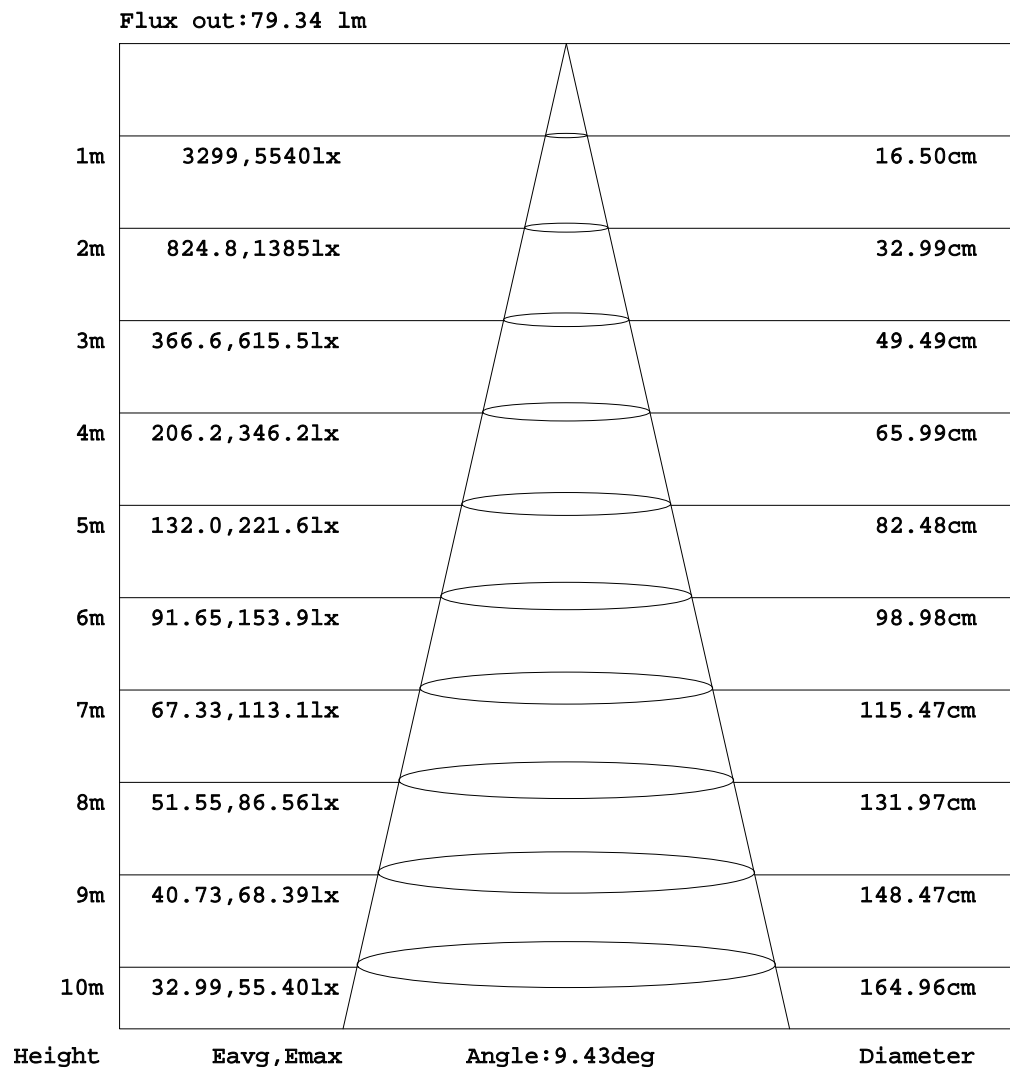

Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:30DEG
 Operators:Simon
 Test Date:2019-08-28

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.417
 Humidity:65.0%
 Test Distance:11.510m [K=1.0000]
 Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:220.74V I:0.0651A P:13.489W PF:0.9381 Freq:50.01Hz Lamp Flux:343.348x1 lm		
NAME: ProPoint Sconce M Green 10Dx5D	TYPE:Sconce	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:1
MFR.: Traxon Technologies	SUR.:	Shielding Angle:

Table--1

UNIT: cd

H (DEG) V (DEG)	-90	-85	-80	-75	-70	-65	-60	-55	-50	-45	-40	-35	-30	-25	-20	-15	-10	-5	0
-180	0.65	0.26	0.00	0.00	0.00	0.00	0.00	0.04	0.15	0.43	1.27	2.36	2.89	3.12	3.25	3.38	3.37	2.95	2.38
-170	0.65	0.28	0.05	0.05	0.05	0.07	0.12	0.24	0.48	0.80	1.72	3.27	3.99	3.55	3.39	3.35	3.36	3.11	2.95
-160	0.65	0.32	0.11	0.11	0.10	0.14	0.21	0.36	0.69	1.05	1.62	2.89	4.32	4.55	3.90	3.55	3.43	3.39	3.42
-150	0.65	0.36	0.18	0.18	0.15	0.18	0.27	0.41	0.68	1.02	1.32	1.81	2.80	3.99	4.76	4.89	4.70	4.50	4.45
-140	0.65	0.41	0.25	0.26	0.25	0.23	0.30	0.38	0.48	0.67	0.97	1.26	1.59	2.06	2.69	3.38	3.80	4.07	4.19
-130	0.65	0.46	0.34	0.34	0.38	0.34	0.31	0.32	0.34	0.42	0.51	0.69	0.94	1.21	1.48	1.66	1.76	1.83	1.86
-120	0.65	0.52	0.43	0.44	0.51	0.54	0.45	0.36	0.32	0.32	0.32	0.36	0.45	0.55	0.66	0.71	0.76	0.78	0.79
-110	0.65	0.57	0.52	0.53	0.60	0.68	0.65	0.59	0.53	0.48	0.40	0.36	0.34	0.33	0.32	0.32	0.31	0.31	0.30
-100	0.65	0.62	0.61	0.63	0.67	0.71	0.71	0.71	0.71	0.71	0.67	0.63	0.58	0.54	0.51	0.51	0.51	0.51	0.52
-90	0.65	0.67	0.69	0.71	0.73	0.75	0.76	0.77	0.78	0.78	0.76	0.73	0.71	0.68	0.68	0.69	0.71	0.72	0.74
-80	0.65	0.71	0.76	0.80	0.82	0.86	0.89	0.94	0.98	1.02	1.02	1.02	1.02	1.02	1.03	1.06	1.08	1.10	1.12
-70	0.65	0.75	0.82	0.86	0.93	1.01	1.07	1.10	1.12	1.13	1.14	1.14	1.15	1.16	1.17	1.18	1.18	1.19	1.19
-60	0.65	0.79	0.85	0.91	0.99	1.08	1.09	1.10	1.11	1.12	1.14	1.16	1.17	1.18	1.17	1.19	1.21	1.23	1.25
-50	0.65	0.81	0.87	0.92	0.96	1.03	1.09	1.10	1.15	1.21	1.27	1.31	1.35	1.41	1.45	1.51	1.57	1.61	1.63
-40	0.65	0.82	0.87	0.87	0.90	0.98	1.06	1.19	1.29	1.38	1.49	1.61	1.76	1.97	2.24	2.66	3.07	3.41	3.47
-30	0.65	0.82	0.86	0.81	0.84	0.95	1.11	1.28	1.45	1.60	1.81	2.14	2.77	5.00	10.9	23.3	38.6	47.3	49.1
-20	0.65	0.83	0.83	0.75	0.80	0.94	1.13	1.32	1.53	1.82	2.26	3.13	7.64	26.9	55.7	68.8	75.3	79.4	83.3
-10	0.65	0.83	0.80	0.69	0.75	0.94	1.13	1.34	1.62	2.05	2.77	4.78	13.3	24.4	33.1	42.4	53.1	75.5	96.2
0	0.65	0.83	0.78	0.64	0.69	0.91	1.08	1.32	1.64	2.16	3.07	5.10	9.78	16.2	26.1	52.3	208	1802	4476
10	0.65	0.83	0.76	0.63	0.70	0.91	1.09	1.32	1.66	2.22	3.20	5.06	8.67	15.0	47.3	199	722	2061	3064
20	0.65	0.82	0.76	0.62	0.68	0.87	1.07	1.26	1.56	2.02	2.79	4.06	7.01	18.9	57.6	157	334	509	597
30	0.65	0.81	0.76	0.62	0.64	0.81	0.98	1.16	1.37	1.61	1.97	2.56	3.58	5.58	11.3	28.7	59.4	85.5	98.7
40	0.65	0.81	0.77	0.63	0.59	0.70	0.87	1.01	1.14	1.27	1.39	1.57	1.88	2.36	2.96	3.71	4.49	5.21	5.59
50	0.65	0.80	0.78	0.66	0.57	0.58	0.70	0.83	0.93	1.01	1.09	1.18	1.31	1.45	1.62	1.76	1.87	1.94	1.98
60	0.65	0.78	0.80	0.72	0.59	0.53	0.52	0.57	0.66	0.74	0.81	0.90	0.99	1.07	1.15	1.17	1.19	1.21	1.21
70	0.65	0.76	0.80	0.77	0.70	0.60	0.52	0.48	0.46	0.45	0.46	0.53	0.60	0.66	0.71	0.73	0.73	0.73	0.72
80	0.65	0.72	0.77	0.79	0.79	0.76	0.72	0.69	0.64	0.60	0.53	0.48	0.44	0.41	0.40	0.41	0.41	0.41	0.41
90	0.65	0.68	0.71	0.75	0.78	0.79	0.77	0.74	0.72	0.70	0.69	0.68	0.67	0.67	0.66	0.66	0.67	0.67	0.67
100	0.65	0.63	0.62	0.60	0.58	0.55	0.51	0.47	0.43	0.40	0.39	0.39	0.41	0.42	0.42	0.40	0.38	0.36	0.35
110	0.65	0.57	0.48	0.40	0.33	0.26	0.19	0.14	0.09	0.05	0.04	0.05	0.07	0.08	0.08	0.06	0.05	0.04	0.03
120	0.65	0.51	0.35	0.22	0.14	0.08	0.04	0.00	0.00	0.00	0.00	0.01	0.01	0.02	0.02	0.03	0.03	0.04	0.05
130	0.65	0.44	0.24	0.10	0.05	0.01	0.00	0.00	0.00	0.00	0.01	0.02	0.03	0.03	0.03	0.04	0.08	0.11	0.13
140	0.65	0.39	0.14	0.05	0.01	0.00	0.00	0.00	0.00	0.01	0.04	0.07	0.12	0.15	0.19	0.25	0.35	0.46	0.50
150	0.65	0.34	0.08	0.02	0.00	0.00	0.00	0.00	0.00	0.01	0.08	0.20	0.45	0.87	1.33	1.64	1.85	2.00	2.05
160	0.65	0.30	0.04	0.01	0.00	0.00	0.00	0.00	0.02	0.08	0.24	0.84	1.65	2.25	2.61	2.79	2.85	2.92	2.96
170	0.65	0.28	0.02	0.00	0.00	0.00	0.00	0.02	0.08	0.25	0.82	1.81	2.51	2.85	3.04	3.20	3.36	3.35	3.37
180	0.65	0.26	0.00	0.00	0.00	0.00	0.00	0.04	0.15	0.43	1.27	2.36	2.89	3.12	3.25	3.38	3.37	2.95	2.38

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:30DEG
Operators:Simon
Test Date:2019-08-28

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.417
Humidity:65.0%
Test Distance:11.510m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:220.74V I:0.0651A P:13.489W PF:0.9381 Freq:50.01Hz Lamp Flux:343.348x1 lm																		
NAME: ProPoint Sconce M Green 10Dx5D									TYPE:Sconce					WEIGHT:				
SPEC.:									DIM.:					SERIAL No.:1				
MFR.: Traxon Technologies									SUR.:					Shielding Angle:				

Table--2

UNIT: cd

H (DEG) V (DEG)	5	10	15	20	25	30	35	40	45	50	55	60	65	70	75	80	85	90	
-180	2.78	3.32	3.28	3.12	2.99	3.55	3.15	1.70	0.93	0.75	0.41	0.18	0.15	0.22	0.49	0.72	0.77	0.79	
-170	3.00	3.29	3.35	3.33	3.25	3.75	3.12	1.71	1.01	0.80	0.43	0.21	0.15	0.22	0.48	0.71	0.77	0.79	
-160	3.40	3.43	3.50	3.70	4.08	3.71	2.42	1.37	1.01	0.73	0.38	0.21	0.16	0.24	0.50	0.71	0.76	0.79	
-150	4.45	4.58	4.64	4.37	3.52	2.44	1.59	1.17	0.90	0.54	0.31	0.19	0.17	0.28	0.54	0.71	0.76	0.79	
-140	3.99	3.65	3.18	2.50	1.90	1.46	1.16	0.85	0.56	0.36	0.23	0.16	0.18	0.37	0.59	0.72	0.76	0.79	
-130	1.81	1.72	1.60	1.41	1.14	0.87	0.62	0.43	0.30	0.20	0.17	0.16	0.28	0.49	0.64	0.73	0.76	0.79	
-120	0.78	0.74	0.69	0.64	0.50	0.38	0.26	0.21	0.19	0.19	0.22	0.33	0.46	0.59	0.69	0.73	0.76	0.79	
-110	0.29	0.29	0.28	0.26	0.25	0.25	0.26	0.30	0.35	0.42	0.49	0.55	0.61	0.66	0.70	0.73	0.76	0.79	
-100	0.49	0.47	0.46	0.45	0.47	0.51	0.56	0.60	0.64	0.66	0.67	0.67	0.66	0.69	0.72	0.74	0.78	0.79	
-90	0.72	0.71	0.69	0.68	0.68	0.71	0.73	0.75	0.78	0.76	0.75	0.74	0.72	0.72	0.74	0.76	0.78	0.79	
-80	1.10	1.08	1.05	1.02	1.01	1.01	1.01	1.00	0.99	0.94	0.90	0.86	0.82	0.80	0.79	0.79	0.79	0.79	
-70	1.18	1.16	1.15	1.13	1.11	1.08	1.06	1.05	1.04	1.01	0.98	0.95	0.92	0.86	0.82	0.80	0.80	0.79	
-60	1.21	1.18	1.14	1.11	1.10	1.08	1.05	1.03	0.98	0.94	0.92	0.93	0.91	0.89	0.86	0.82	0.80	0.79	
-50	1.55	1.46	1.36	1.27	1.20	1.15	1.10	1.05	0.98	0.91	0.87	0.84	0.86	0.87	0.86	0.83	0.81	0.79	
-40	3.17	2.68	2.20	1.80	1.52	1.32	1.19	1.07	0.99	0.90	0.83	0.82	0.81	0.84	0.85	0.83	0.81	0.79	
-30	43.8	31.9	17.1	7.76	3.41	1.98	1.50	1.23	1.05	0.92	0.89	0.87	0.84	0.81	0.82	0.83	0.81	0.79	
-20	79.0	74.0	64.4	44.1	17.5	4.86	2.21	1.54	1.29	1.14	1.06	0.97	0.88	0.80	0.80	0.82	0.81	0.79	
-10	75.6	52.7	41.2	31.2	20.0	8.83	3.50	2.28	1.74	1.44	1.26	1.09	0.95	0.82	0.78	0.82	0.81	0.79	
0	1744	196	48.7	25.0	15.2	8.28	4.32	2.88	2.12	1.71	1.43	1.19	1.00	0.82	0.77	0.81	0.81	0.79	
10	1955	593	164	43.1	14.7	8.07	4.80	3.16	2.25	1.73	1.41	1.18	0.98	0.81	0.75	0.79	0.81	0.79	
20	487	303	132	41.2	14.4	6.54	4.10	2.86	2.07	1.61	1.32	1.12	0.92	0.77	0.72	0.78	0.81	0.79	
30	80.0	50.8	23.4	9.86	5.43	3.60	2.59	2.01	1.66	1.39	1.19	1.02	0.85	0.72	0.70	0.77	0.81	0.79	
40	5.17	4.45	3.71	2.97	2.36	1.88	1.57	1.41	1.27	1.15	1.03	0.89	0.74	0.66	0.70	0.77	0.81	0.79	
50	1.95	1.88	1.79	1.64	1.47	1.32	1.18	1.08	1.00	0.92	0.83	0.71	0.62	0.63	0.70	0.78	0.81	0.79	
60	1.21	1.20	1.18	1.16	1.08	1.00	0.90	0.81	0.74	0.67	0.59	0.55	0.57	0.63	0.74	0.80	0.81	0.79	
70	0.73	0.73	0.73	0.72	0.68	0.61	0.54	0.48	0.46	0.49	0.52	0.56	0.66	0.74	0.80	0.80	0.80	0.79	
80	0.41	0.41	0.42	0.42	0.43	0.47	0.52	0.58	0.64	0.68	0.73	0.77	0.79	0.80	0.80	0.80	0.80	0.79	
90	0.67	0.68	0.68	0.68	0.69	0.70	0.71	0.72	0.73	0.75	0.76	0.78	0.79	0.80	0.80	0.80	0.80	0.79	
100	0.36	0.39	0.41	0.44	0.44	0.42	0.41	0.41	0.42	0.45	0.49	0.54	0.59	0.66	0.73	0.77	0.80	0.79	
110	0.04	0.05	0.06	0.08	0.08	0.07	0.05	0.05	0.05	0.09	0.15	0.21	0.29	0.46	0.61	0.72	0.78	0.79	
120	0.04	0.03	0.03	0.02	0.02	0.01	0.01	0.01	0.00	0.00	0.00	0.04	0.11	0.31	0.52	0.68	0.76	0.79	
130	0.11	0.09	0.06	0.04	0.04	0.04	0.04	0.02	0.01	0.00	0.00	0.00	0.06	0.24	0.46	0.65	0.76	0.79	
140	0.46	0.36	0.24	0.19	0.14	0.12	0.09	0.04	0.02	0.01	0.00	0.02	0.07	0.21	0.43	0.64	0.75	0.79	
150	2.01	1.86	1.67	1.36	0.91	0.48	0.22	0.09	0.02	0.00	0.02	0.04	0.08	0.19	0.43	0.64	0.75	0.79	
160	2.88	2.80	2.74	2.60	2.27	1.72	0.91	0.31	0.19	0.16	0.11	0.07	0.09	0.19	0.43	0.65	0.75	0.79	
170	3.26	3.24	3.11	2.97	2.82	2.74	2.12	1.04	0.57	0.46	0.25	0.13	0.12	0.20	0.44	0.68	0.76	0.79	
180	2.78	3.32	3.28	3.12	2.99	3.55	3.15	1.70	0.93	0.75	0.41	0.18	0.15	0.22	0.49	0.72	0.77	0.79	

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:30DEG
 Operators:Simon
 Test Date:2019-08-28

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.417
 Humidity:65.0%
 Test Distance:11.510m [K=1.0000]
 Remarks: